
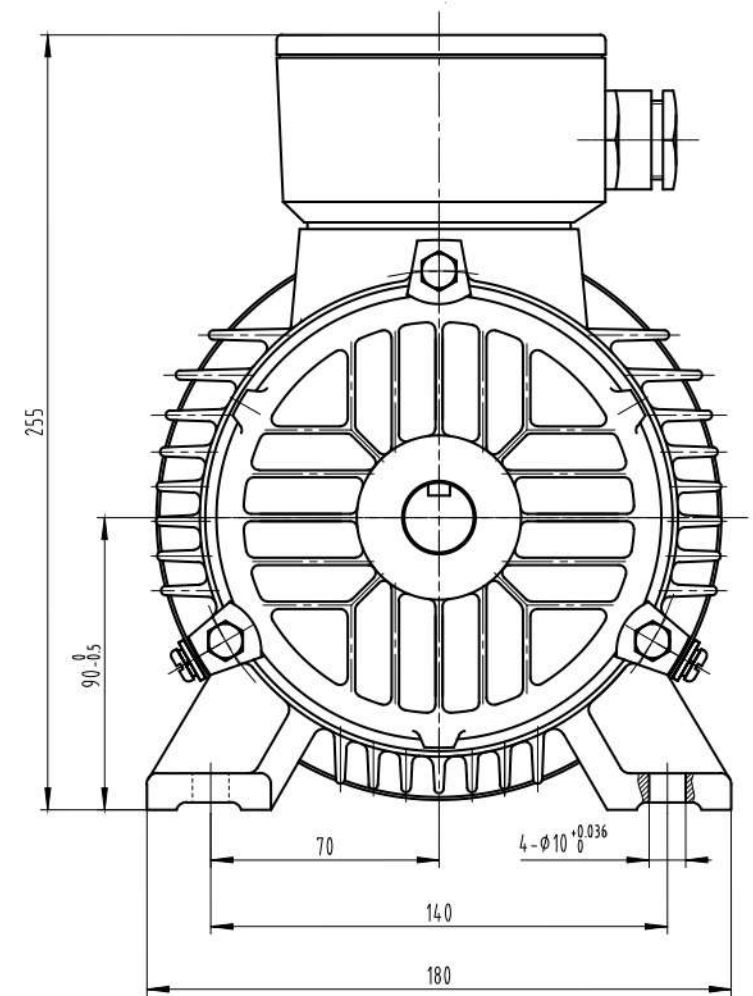


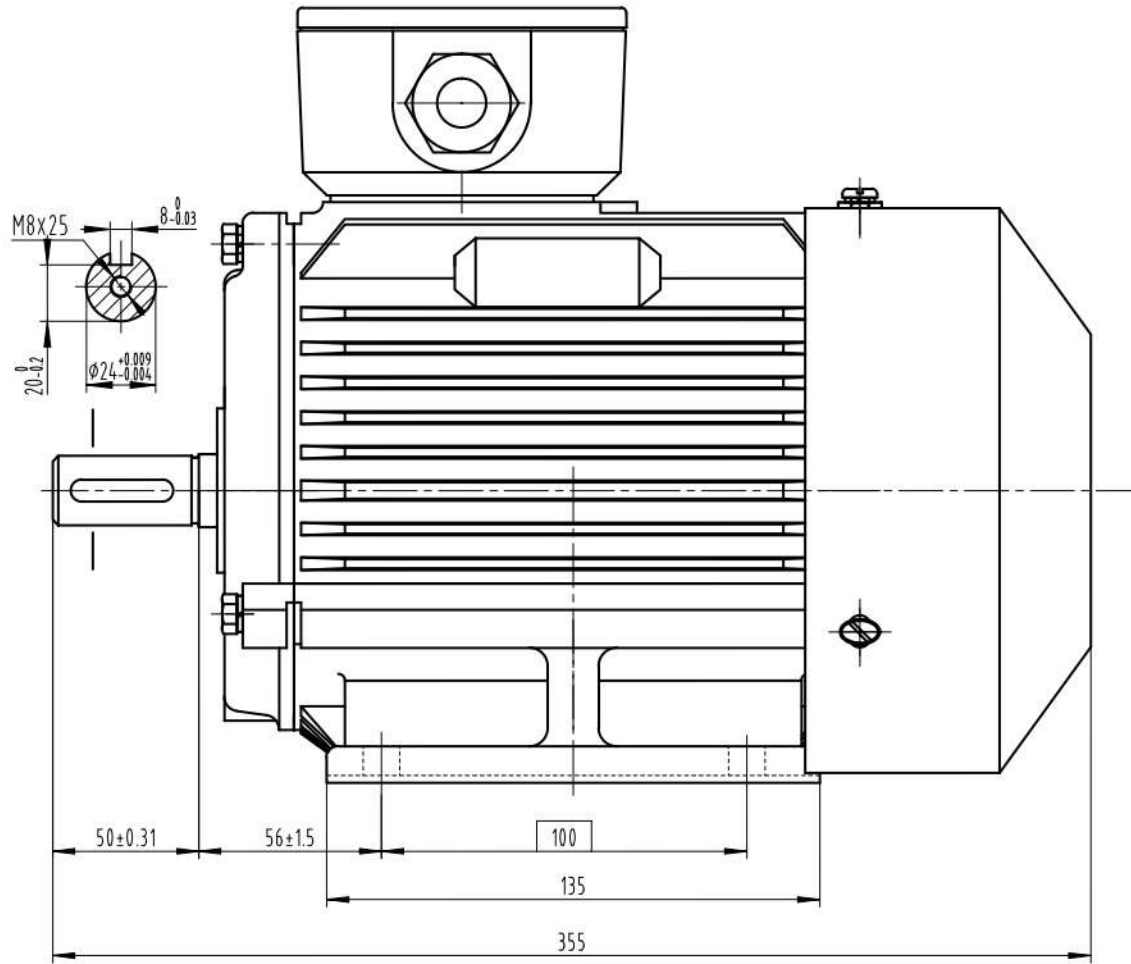

TYPE	kW	V	A	Hz	r/min	EFF(%)	cosφ	T _{max} /T _N	T _{st} /T _N	Ins.CL	CONN	Rtg	IM	IP	Bearing DE	Bearing NDE
KE3-90S-4	1.1	220/440	4.5/2.25	60	1420	84.1%	0.76	2.3	2.3	F	Δ/Y	S1	B3	55	6205 C3	6205 C3